


2 LO 0 L Q G H U ' X S O H [V W H P % R [2 0) O R D W V				
' Z J	DS-B04-011	5 H Y	' D W I 8 / 1 7	6 H U L A H S

& R Q V W U X F W L R Q

0 R W R U ' H V L J Q	Induction	0 R W R U + R X V L Q J	Stainless Steel
0 R W R U 7 \ S H	Enclosed submersible	9 R O X W H	Cast Iron
, Q V X O D W L R Q & O C	Class B	([W H U Q D O + D U G Z	Stainless Steel
0 R W R U 3 U R W H F W	Bi-metallic Thermal Switch	2 5 L Q J V	Nitrile (Buna N)
% D H W D O O L F 7 H P	120° C ± 5° C	0 R W R U 6 K D I W	Stainless Steel
0 D [) O X L G W H P S	104°F (40°C)	, P S H O O H U	Hytrel
8 S S H U K D I W 6 H D O	carbon/ceramic	/ R Z H U 6 K D I W 6 H D	Sic/Sic



& R Q U X U D W L R Q V

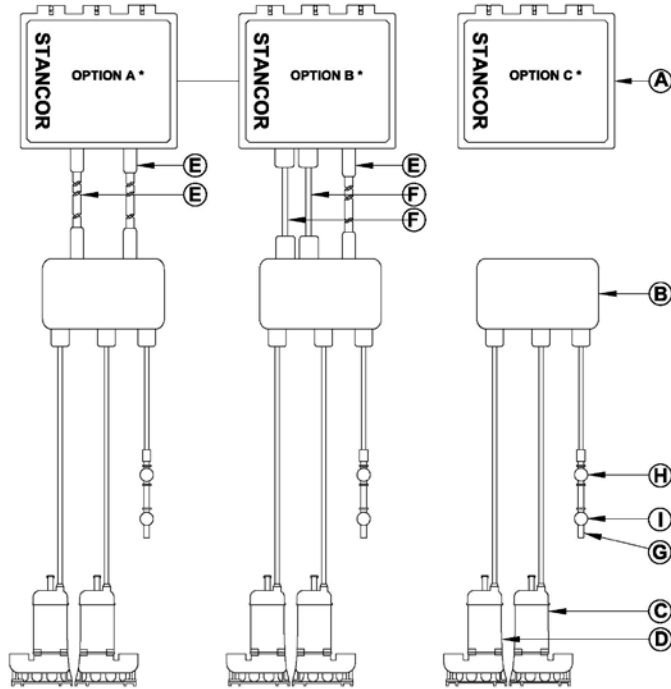

, W H	' H V F U L S W L R Q
\$	Control Panel
%	J-Box
&	Pump A
'	Pump B
(8 Pin Cable
)	Pump Power Cable
*	Sensor Probe
+	High Float
,	ON Float

6 H H 2 0 & R Q I L J X U D
I R U V S H F L I L F R S W

, Q V W O D W L R Q ' L P H Q V L R Q V

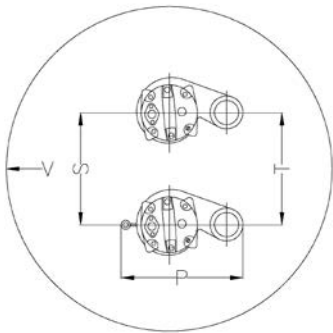

, W H	' H V F U L S W L R Q
3	Pump with OM-300 Dist.
4	Dist. To handle
6	Min. Pump Dist.**
7	Min. Fitting Dist.***
9	Min. Sump Ø
;	Pump ON
<	Pump OFF
=	High Alarm

6 H H 2 0 R Q I L J X U D W L F
I R U V S H F L I L F G L P H G

0 L Q I X P G L V W D Q F H U H T X L U H G
I R U S U R S H U S X P S S H U I R U P D Q F H

) L W W L Q J G L P H Q V L R Q V D U H
E D V H G \$ R Q \$ 6 0 %
V W D Q G D U G V